
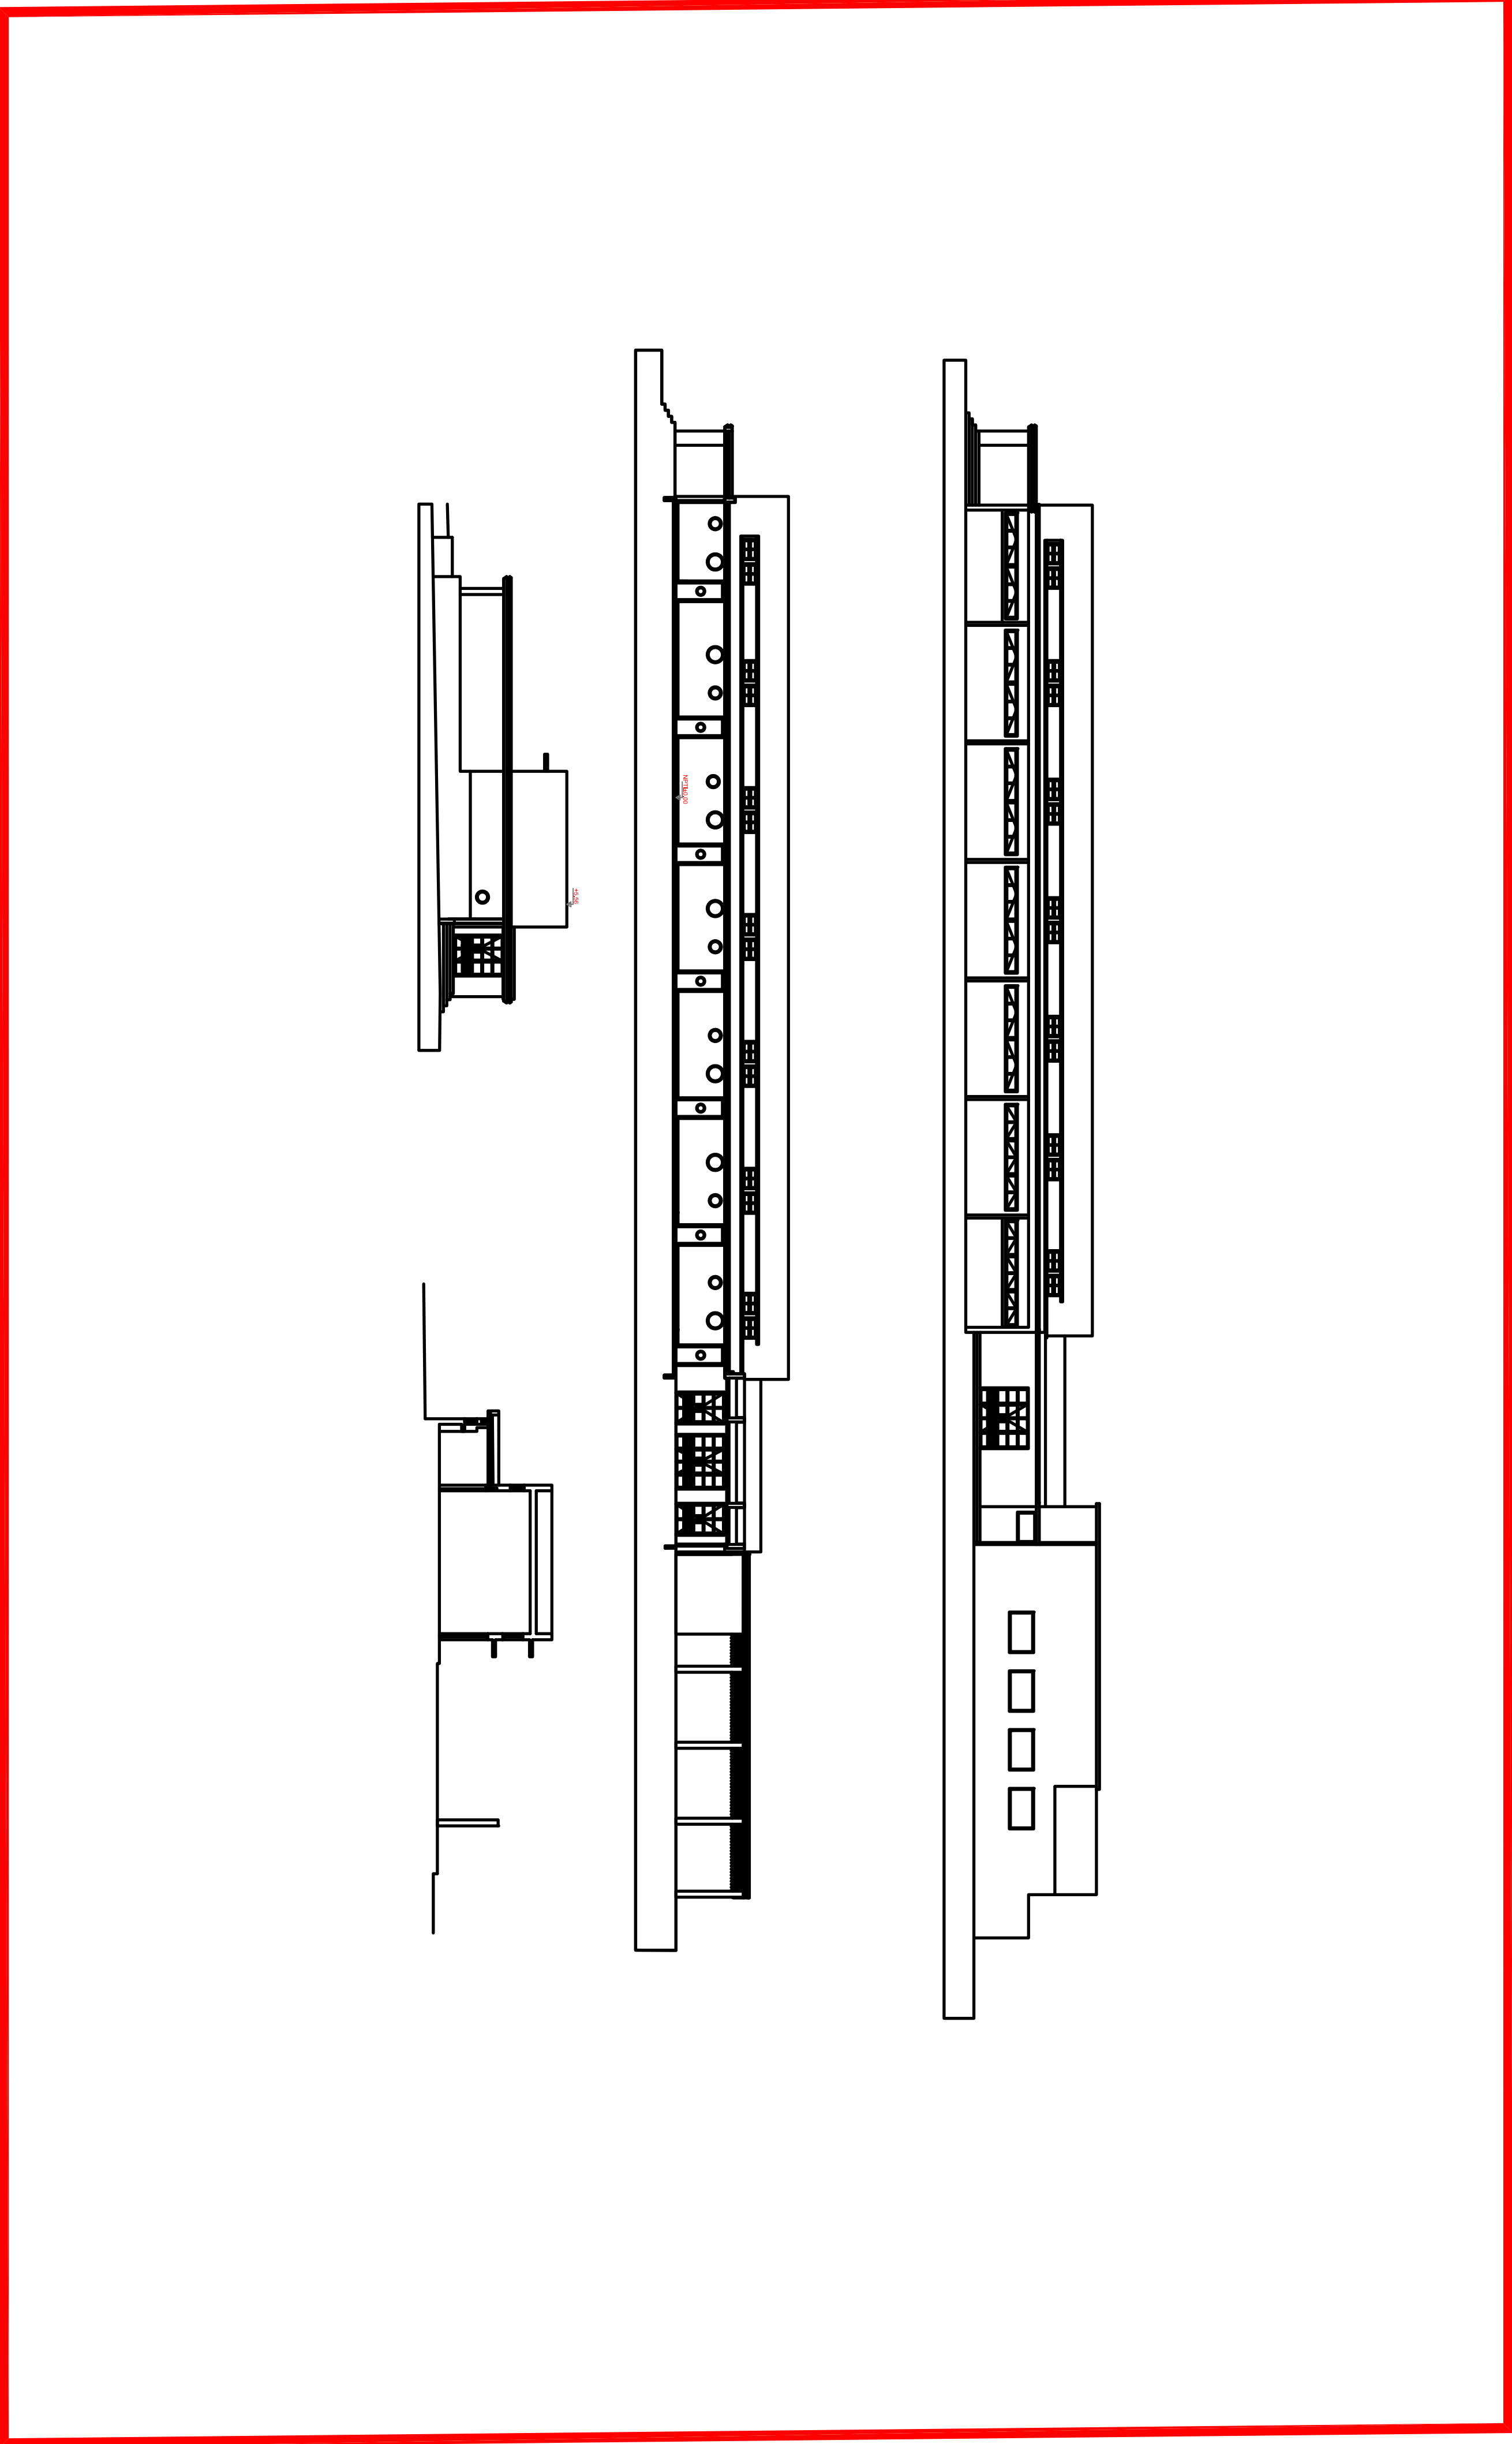
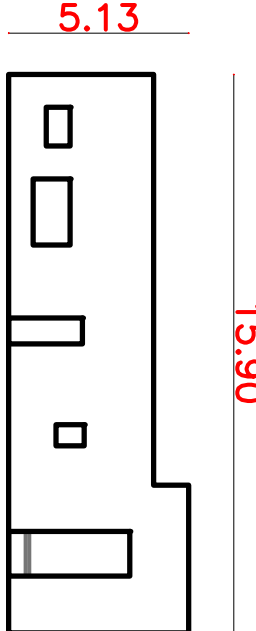
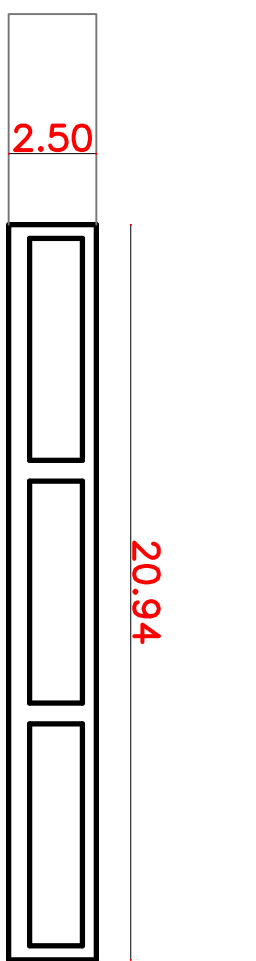




ALZADOS

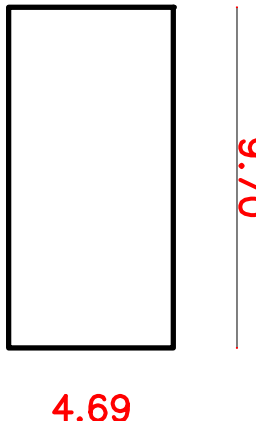

SEPARACIÓN DE RIESGO

estudio entre fachadas A y B				estudio entre fachadas C y D			
 fachada A	 fachada B	 fachada C	 fachada D	fachada expuesta			
69.90 m <sup>2</sup>	52.35 m <sup>2</sup>	5.95 m <sup>2</sup>	45.45 m <sup>2</sup>	área fachada			
60.75 m <sup>2</sup>	23.90 m <sup>2</sup>	0.00 m <sup>2</sup>	45.45 m <sup>2</sup>	área de llenos			
9.14 m <sup>2</sup>	28.45 m <sup>2</sup>	5.95 m <sup>2</sup>	00.00 m <sup>2</sup>	área de vanos			
15.90 m / 5.13 m = 3.10 dimensión menor 5,13m	20.94 m / 2.50 m = 8.38 dimensión menor 2,50 m	2.79 m / 2.13 m = 1.31 dimensión menor 2,13 m	9.70 m / 4.69 m = 2.07 dimensión menor 4,69 m	relación alto con ancho			
11.23 %	54.35 %	100 %	0.00 %	% vanos sobre llenos			

ÁREA DE CÁLCULO SEGÚN DECRETO 184/018

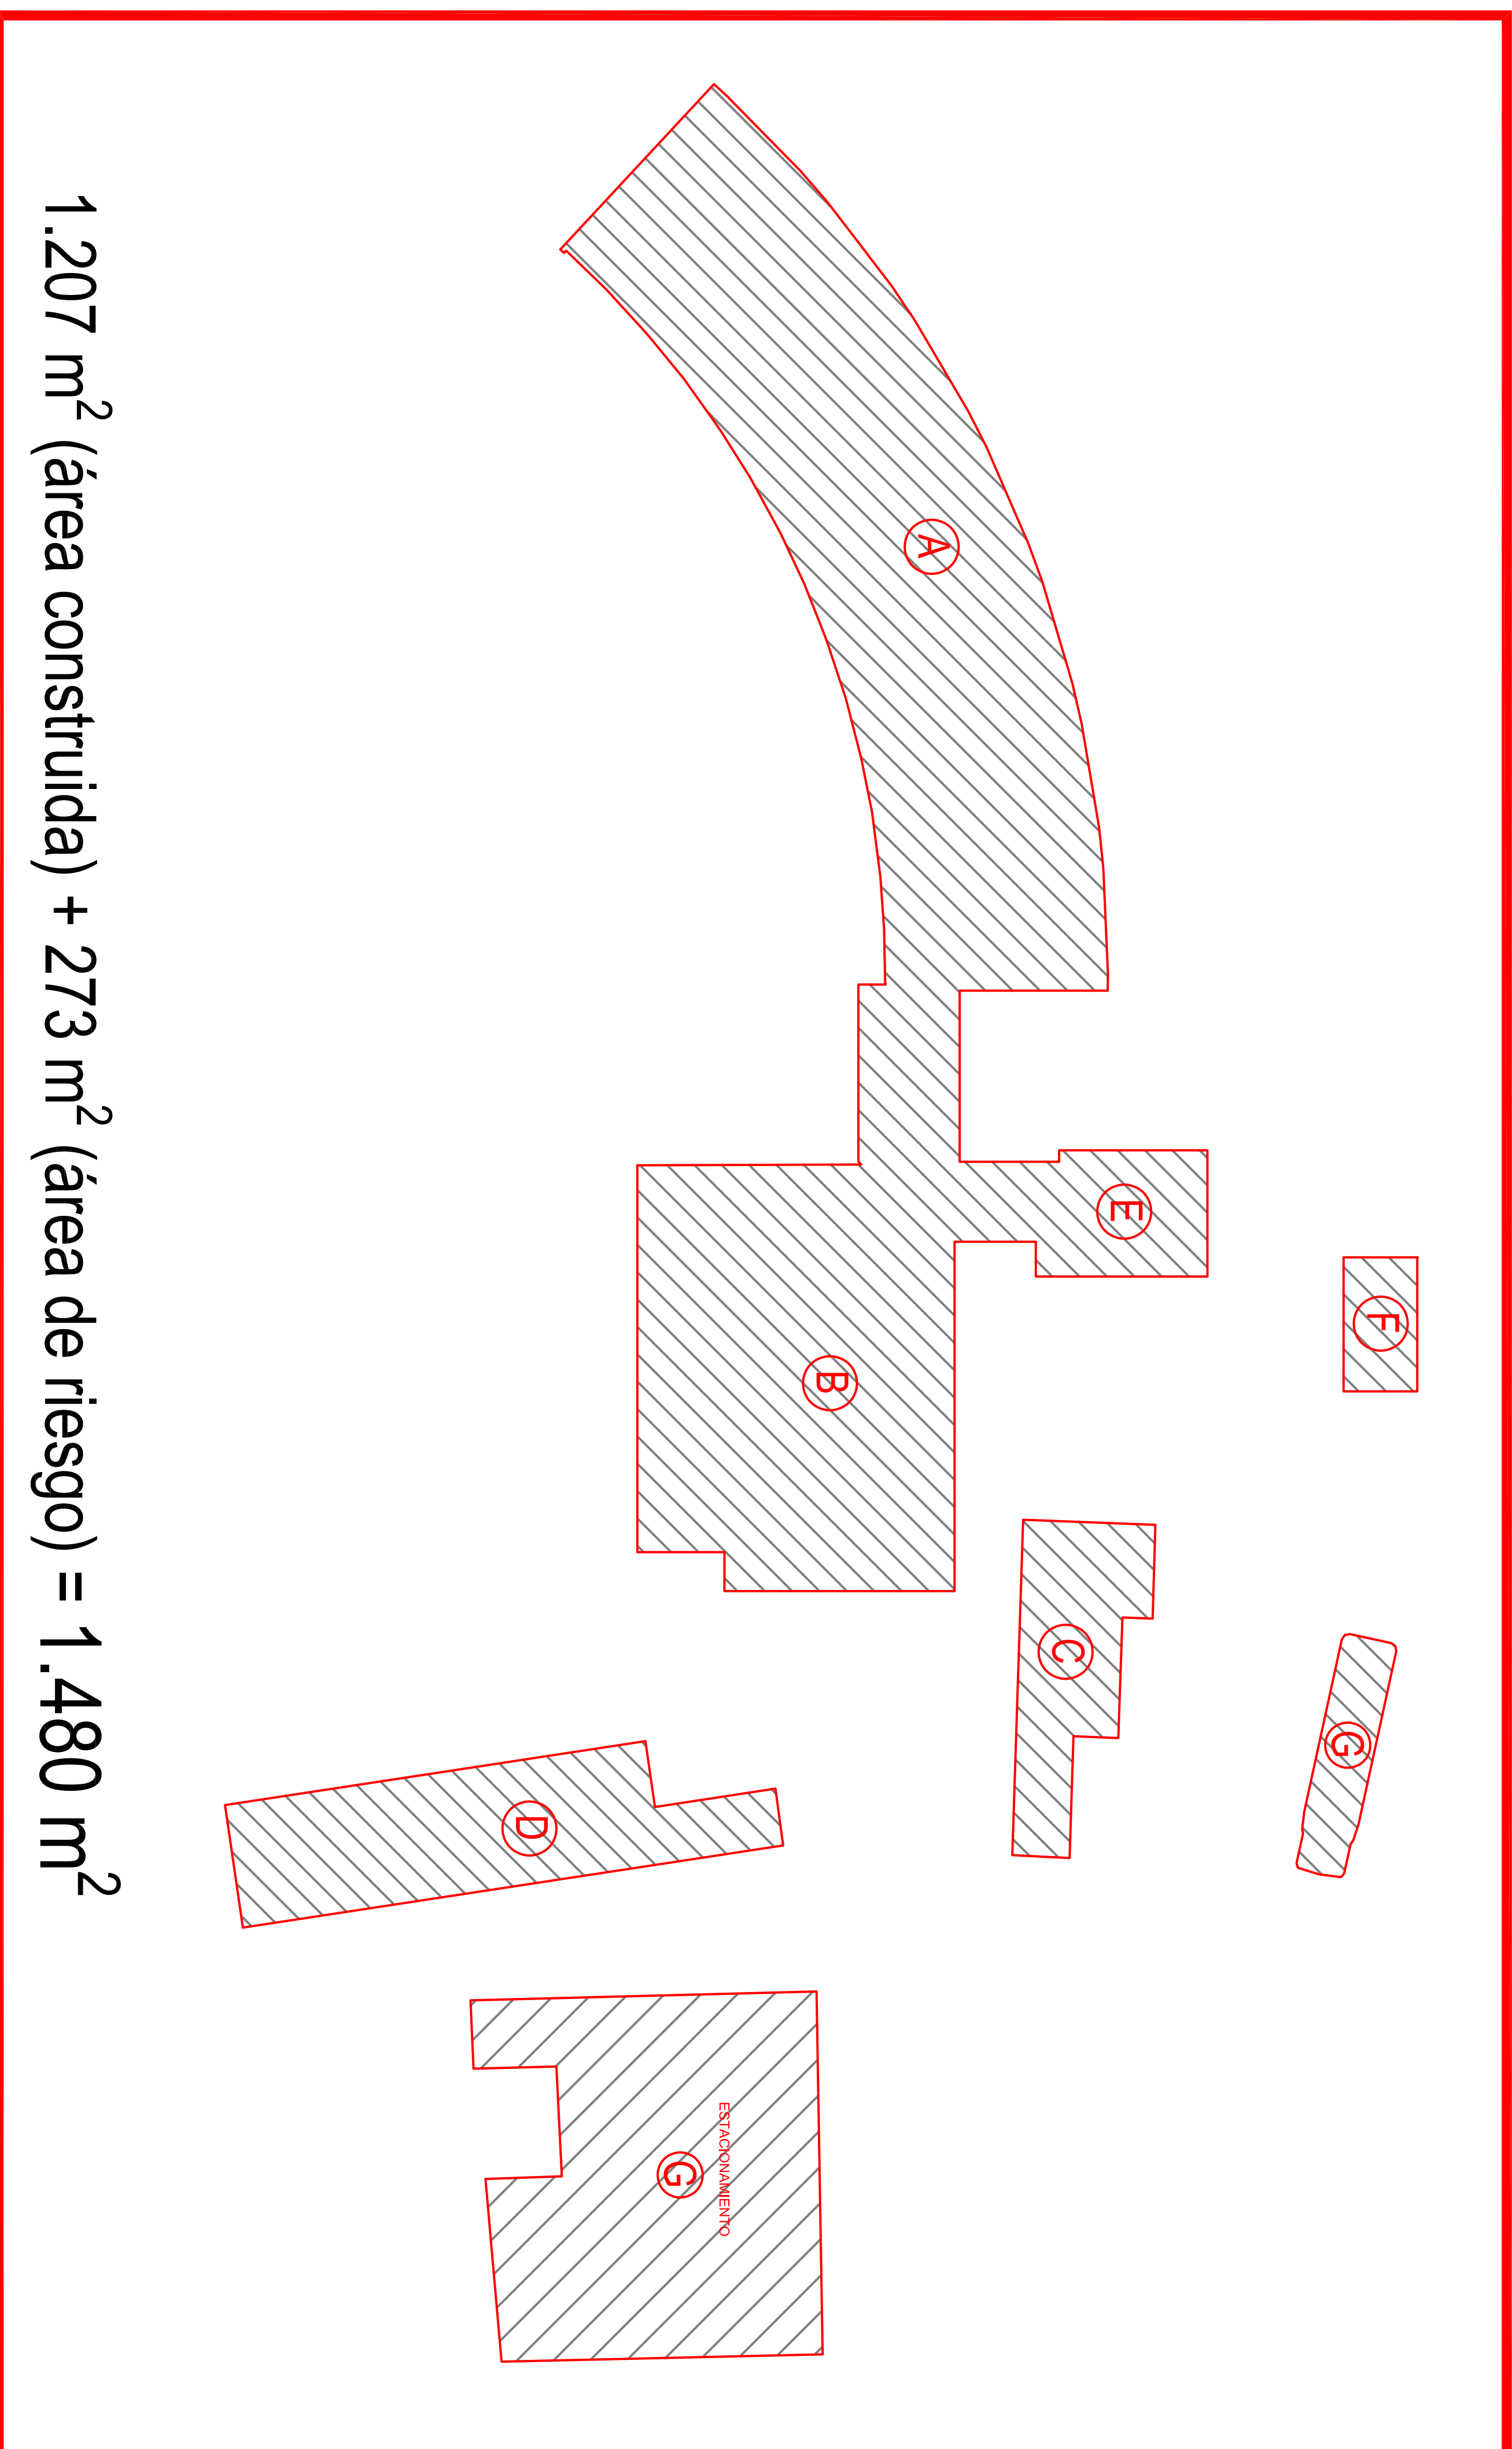

POBLACIÓN SEGÚN IT 19 \_ área exclusiva de aulas y zona administrativa

